


Study HIGH Quality H12-425_V2.0-ENU Free Study Guides and Exams Tutorials [Q10-Q26]

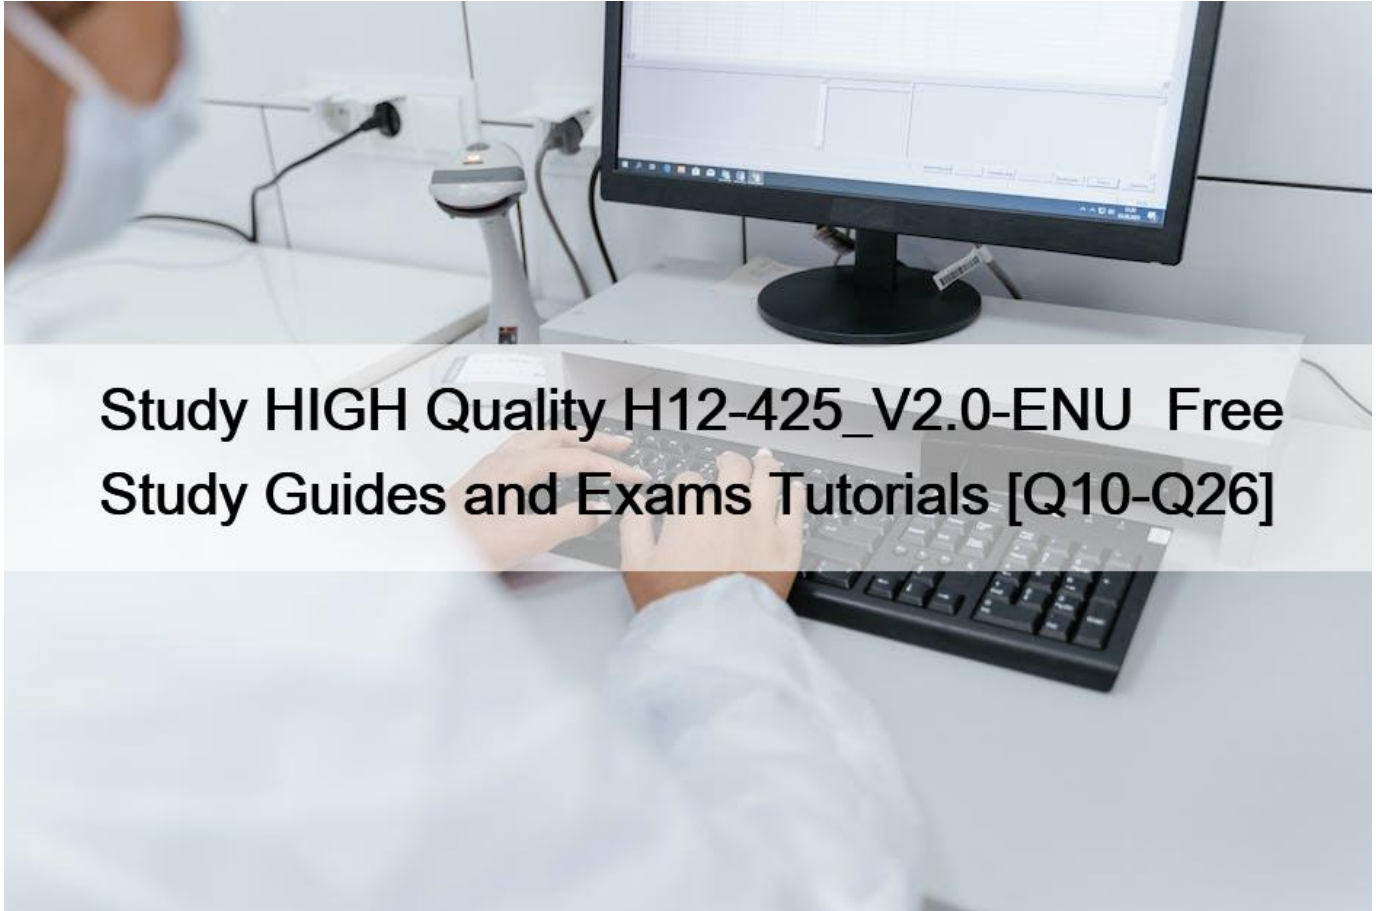

Study HIGH Quality H12-425_V2.0-ENU Free Study Guides and Exams Tutorials [Q10-Q26]

Study HIGH Quality H12-425_V2.0-ENU Free Study Guides and Exams Tutorials
Download Huawei H12-425_V2.0-ENU Exam Dumps to Pass Exam Easily

NO.10 In the UPS5000 configurator, what are the optional module types? (Multiple choice)

- * 50k high efficiency
- * 25k
- * 50k standard effect
- * 60k

NO.11 What are the alarm management functions supported by the ECC800? (Multiple choice)

- * View historical alarms
- * Filter alerts
- * Alarm data export
- * Alarm parameter setting

NO.12 What is the maximum IT load supported by the FusionModule2000 integrated UPS?

- * 50kW

- * 125kW
- * 150kW
- * 75kW

NO.13 FusionModule800 can only support down pipe.

- * True
- * False

NO.14 When installing the UPS500-E, a certain distance should be left behind and above to ensure ventilation and heat dissipation.

- * True
- * False

NO.15 NetEco6000 management system can realize APP + intelligent inspection, greatly reducing operation and maintenance man-hours.

- * True
- * False

NO.16 What are the optional functions in PDU8000? (Multiple choice)

- * Input switch remote tripping function
- * Temperature Monitoring Feature Function
- * Branch switch hot swap function
- * 9 earthquake resistance

NO.17 What is a gas fire extinguishing device composed of? (Multiple choice)

- * Fire Air
- * Pressure switch
- * Sound and light alarm
- * Solenoid valve

NO.18 In UPS, corresponding to 50k modules, the maximum output capacity of a single UPS is?

- * 500kVA
- * 400kVA
- * 800kVA
- * 600kVA

NO.19 UPS5000-A has built-in SNMP and ModBus card, which reduces the management investment cost of customers.

- * True
- * False

NO.20 When the battery is discharged, the discharge voltage of a faulty battery drops rapidly, and the backup time of the entire battery rented in the morning is not enough, so it should be dealt with ().

- * Force equal charge, replace the faulty battery
- * No processing required
- * Scrap the entire battery pack
- * to discharge

NO.21 UPS2000-G- (6-20KVA) battery is not connected, which does not affect the normal power supply of the system.

- * True
- * False

NO.22 If the NETCOL5000-A air-conditioning unit operates abnormally, you should check whether the compressor, fan, and pipe lights are fixed properly and whether there is any looseness.

- * True
- * False

NO.23 The FusionModule2000 battery is listed in the scene, supporting up to () battery cabinets?

- * 4
- * 6
- * 2
- * 8

NO.24 The dry contact signal of UPS5000-E does not support the remote emergency stop function.

- * TRUE
- * FALSE

NO.25 The UPS5000-E power ches block adopts a fan fault-tolerant design. When two of the fans are damaged, what percentage of the power module can still be loaded?

- * 0.3
- * 0.5
- * 0.2
- * 0.6

NO.26 Huawei's main temperature control solution for small and medium-sized computer rooms is?

- * Row-level chilled water with micro-modules
- * Room-level air cooling solution
- * Room-level chilled water solution
- * Row-level air cooling with micro-modules

Get 100% Real Free HCIP-DCF-BFDO H12-425_V2.0-ENU Sample Questions:

https://www.vceprep.com/H12-425_V2.0-ENU-latest-vce-prep.html